



NEW STYLE TRANSFER ASSEMBLY (Old Style Switch Other Side)
 Allows multiple RXT transfer switches to be installed in series WITHOUT the installation of an RDT transfer switch

ATTENTION: JUMPER MUST BE INSTALLED OR THE PRODUCT WARRANTY WILL BE VOIDED

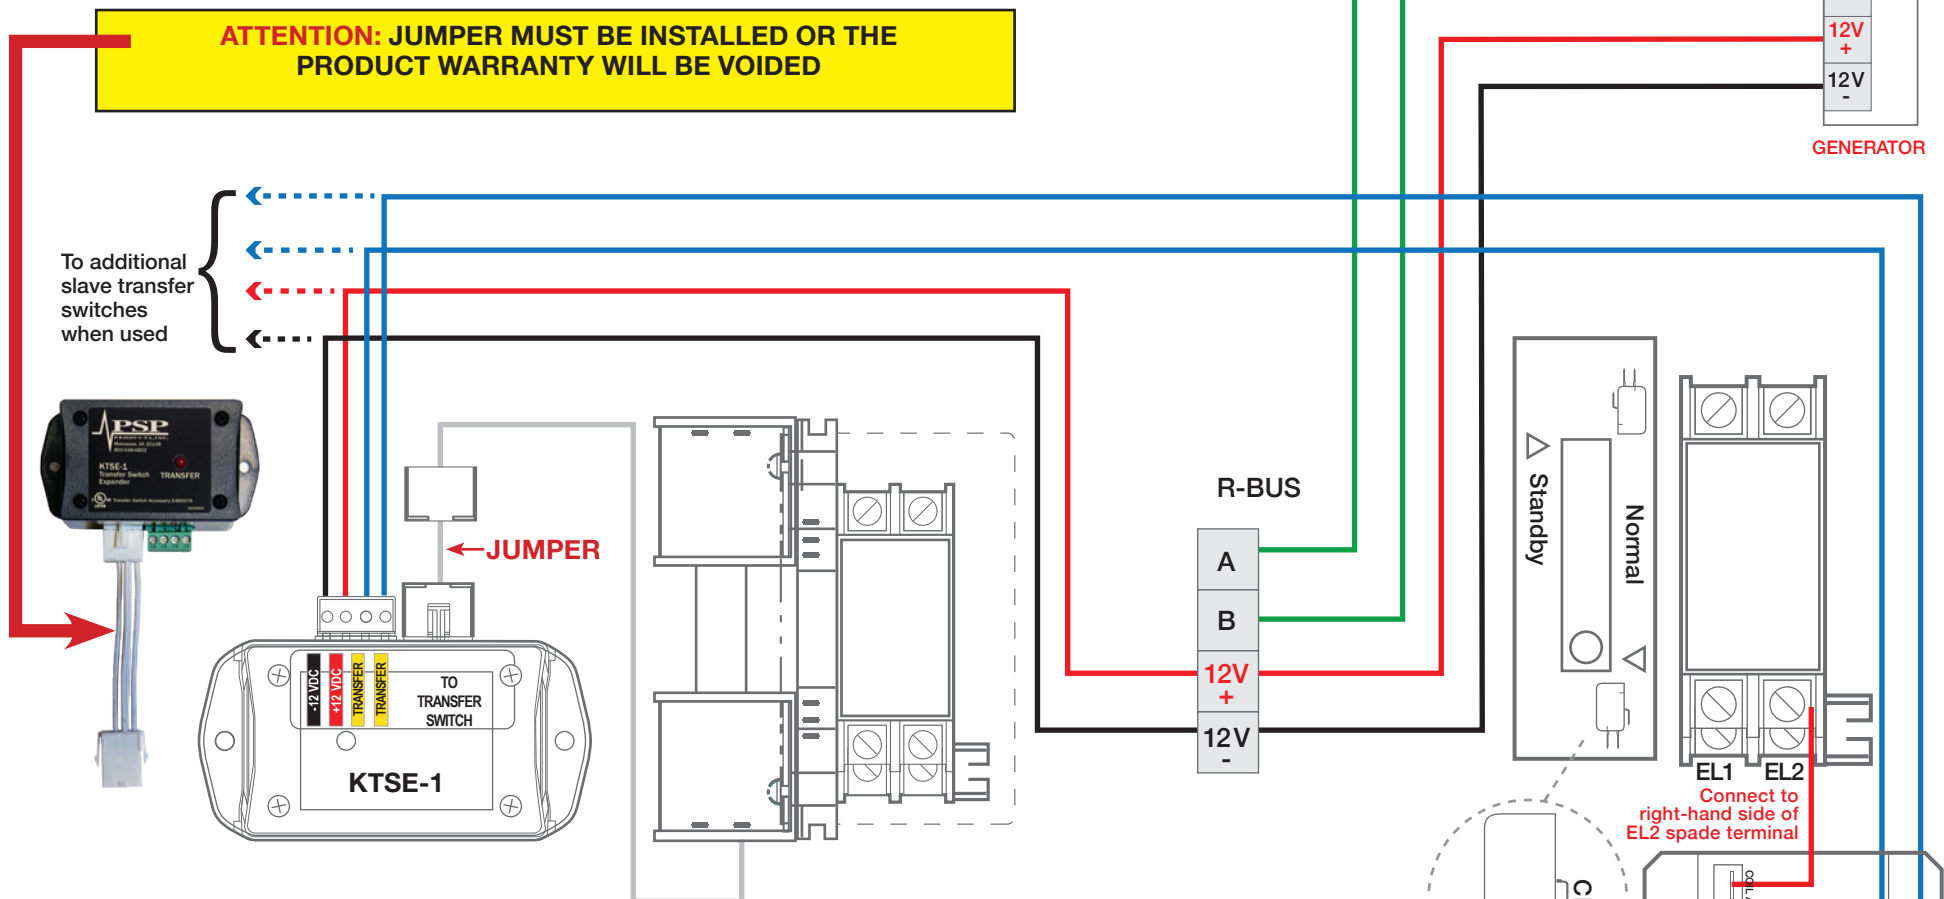

Remove connector P-13 and remove RXT control board. Insert connector P-13 plug into KTSE-1 Expander Module and attach to side panel of enclosure. Note: The RXT control board is not required to operate the transfer switch in the SLAVE mode and can be returned to inventory.

SLAVE RXT

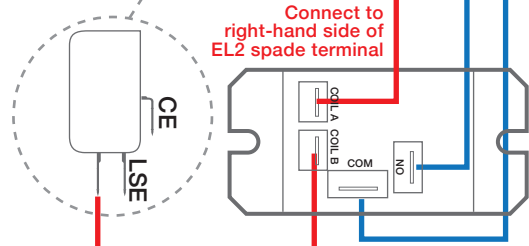

Connect coil B to the ONLY open terminal on the bottom micro-switch

MASTER RXT


Technical Assistance Call: 703-687-4057



Important: Risk of electrical shock.
 This device should only be installed by qualified personnel.

OLD STYLE TRANSFER ASSEMBLY

Allows multiple RXT transfer switches to be installed in series WITHOUT the installation of an RDT transfer switch

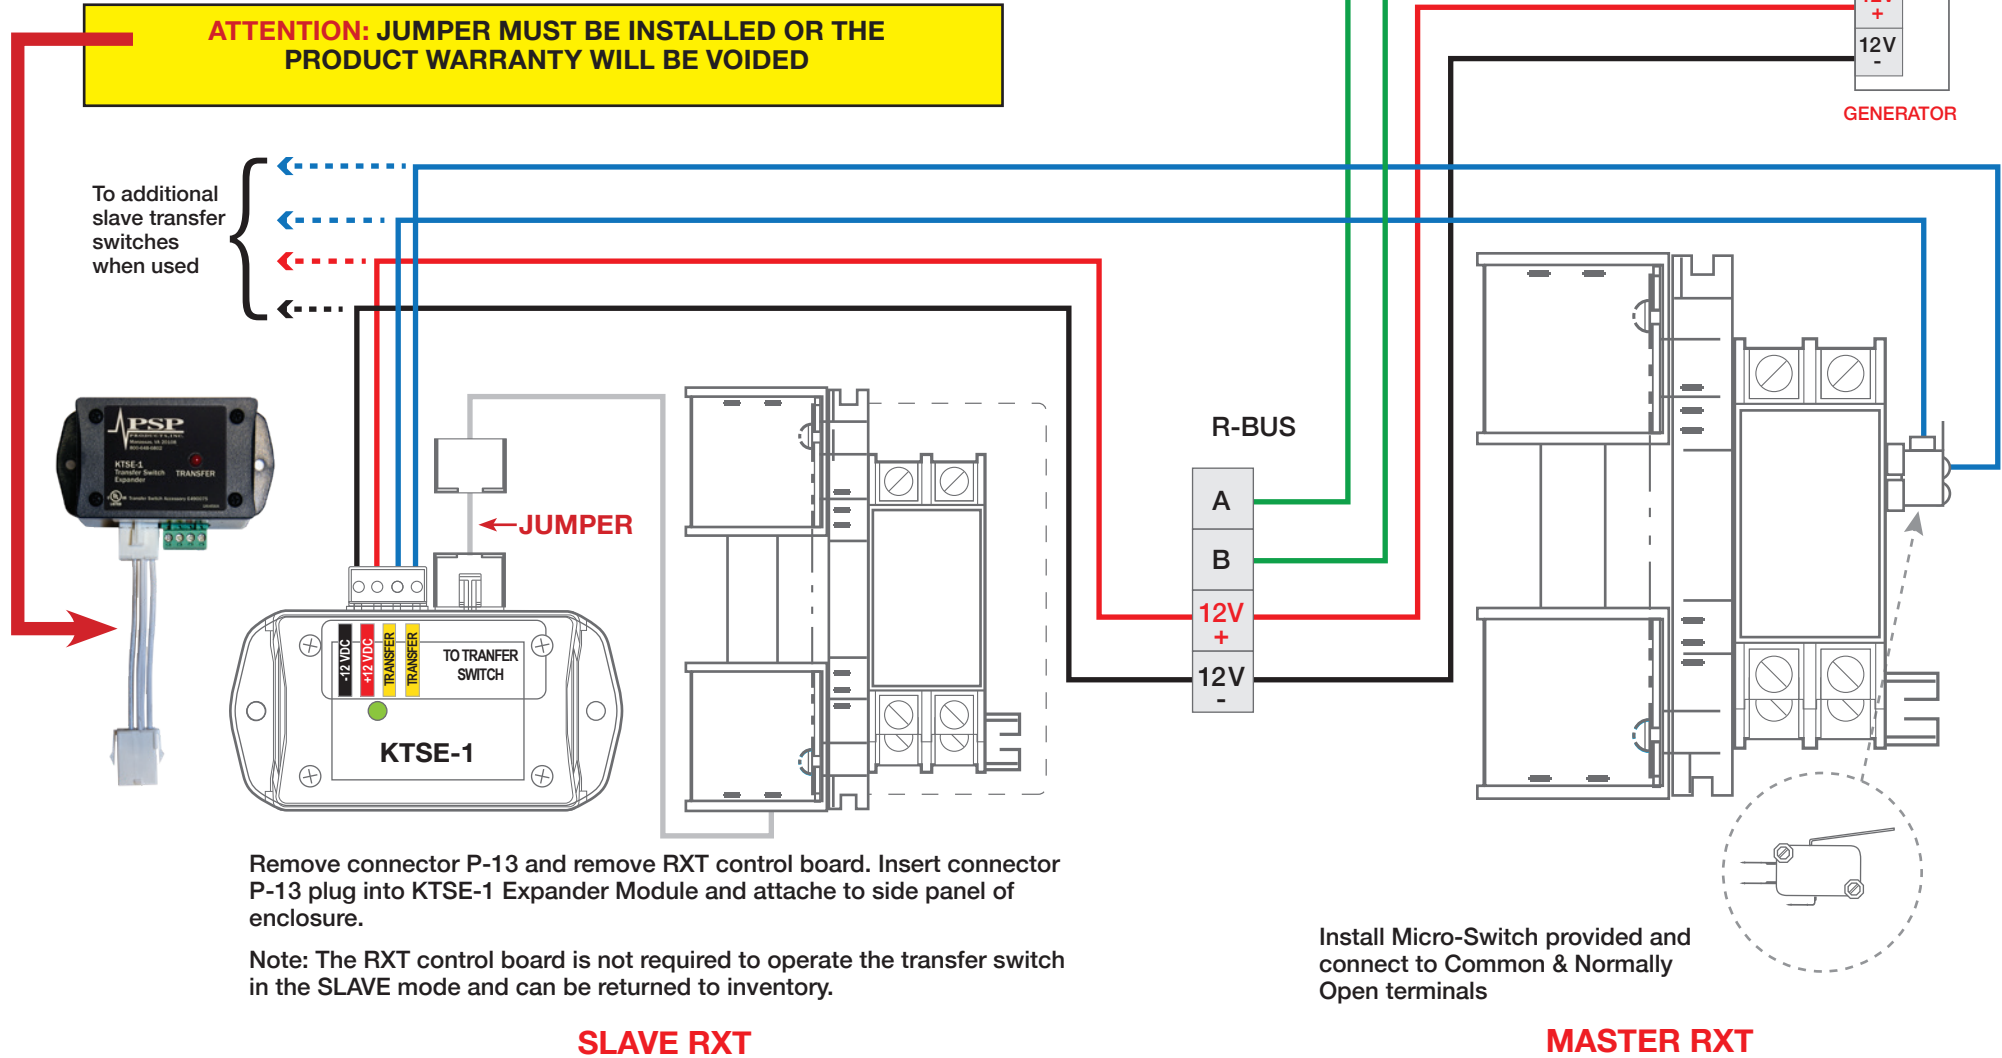

Important: Risk of electrical shock.
This device should only be installed by qualified personnel.

Technical Assistance Call: 703-687-4057